

LIGHT DISTRIBUTION TESTING PARAMETERS

Luminaire Property

Luminaire Manufacturer:
Voltage: 119.5 V
Power: 231.74 W


Current: 1.935 A
Power Factor: 0.998

Photometric Results


IES Classification: Type III
Total Rated Lamp Lumens: 29974.5 lm
Efficiency: 100%
Upward Ratio: 0%
Central Intensity: 6862.86 cd
Pos of Max. Intensity: H22.5 V69

Longitudinal Classification: Medium
Measurement Flux: 29974.5 lm
Downward Ratio: 100%
Luminaire Efficacy Rating (LER): 129.35
Max. Intensity: 9215.43 cd

Luminous Intensity Distribution Curve

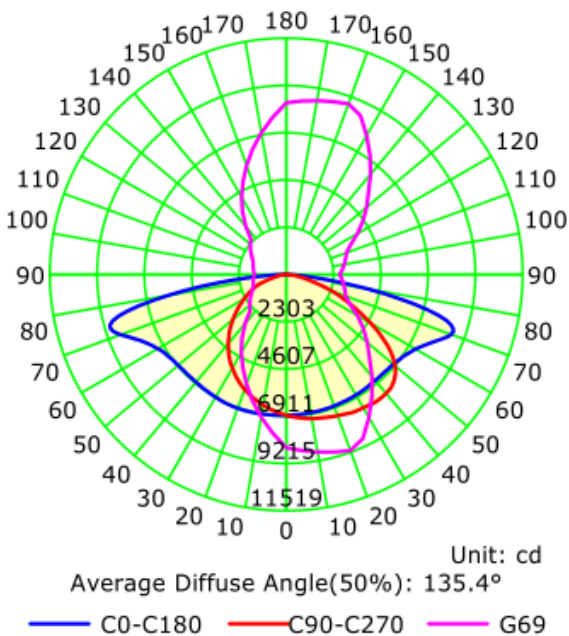

The Average Illuminance Effective Figure

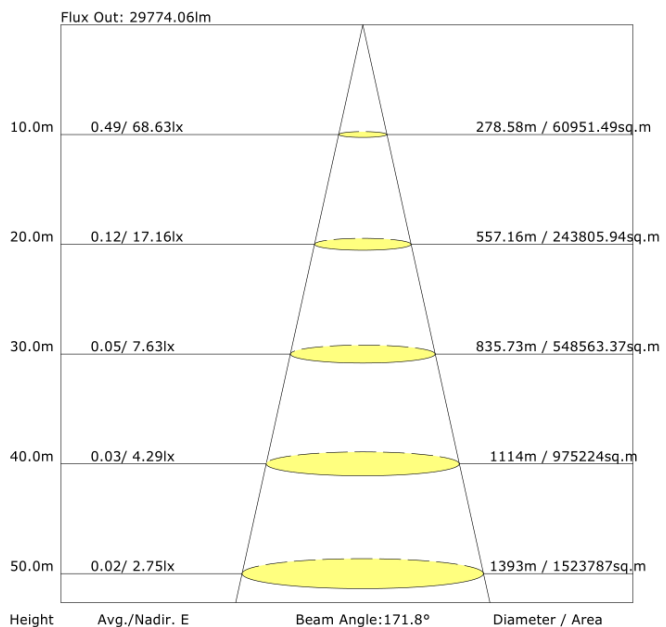

NOTICE FOR USER

- Please turn off power before install or change assembly parts.
- The input voltage and lamps should be matched, after connecting the power line, Please make sure the wiring section is insulated.
- No-professionals, must not install and disassemble the lamps.

TROUBLE SHOOTINGS

Troubles	Check points
Flickering of the light	Turn off the power and turn on again in 3 minutes. If same phenomena occur, then call agencies.
Out of working	Please check the connection.